



University at Buffalo

Center for Inclusive Design and Environmental Access School of Architecture and Planning

> 309 Hayes Hall Buffalo, NY 14214-8030 TEL: (716) 829-5902

## NOT FOR CONSTRUCTION

NOTES

1. EXTERIOR WALL STUDS ARE ASSUMED 2" X 8" (NOM.). VERIFY IF SUFFICIENT GIVEN REGIONAL ENERGY REQUIREMENTS.

2. INTERIOR WALL STUDS ARE ASSUMED 2" X 4" 3. WALLS ARE ASSUMED 92-5/8" PRE-CUT STUDS W/ ONE BOTTOM PLATE & TWO TOP PLATES. 4. FLOOR JOISTS ARE ASSUMED 2" X 10" (NOM.).

WOOD SPECIES/GRADE. 5. SUBFLOORS ARE ASSUMED 5/8" PLYWOOD. 6. EXTERIOR WALL SHEATHING IS ASSUMED 5/8" PLYWOOD. SIDING IS NOT DEPICTED IN PLAN VIEW.

VERIFY IF SUFFICIENT BASED ON LOCAL CODE &

7. INTERIOR WALL FINISHES ARE ASSUMED 1/2" 8. CEILING FINISH IS ASSUMED 5/8" DRYWALL. 9. INTERIOR FLOOR FINISHES ARE NOT DEPICTED IN

THIS WORK. FLOOR FINISHES TO BE SMOOTH, STABLE, FIRM, & SLIP-RESISTANT. WHERE CARPET IS PROVIDED, CARPET PILE IS TO BE NO HIGHER THAN  $\frac{1}{2}$ ". TRANSITIONS BETWEEN FLOOR FINISHES SHOULD BE SMOOTH & FLUSH WHEREVER POSSIBLE. WHERE NOT POSSIBLE, THE MAXIMUM VERTICAL LEVEL CHANGE IS  $\frac{1}{4}$ ". THE MAXIMUM BEVELED LEVEL CHANGE IS  $\frac{1}{2}$ ", PROVIDED THE TOP 1/4" IS BEVELED AT A MAXIMUM SLOPE OF 1:2.

10. ROOF SLOPES ARE EQUAL ON EITHER SIDE OF RIDGE UNLESS OTHERWISE NOTED. 11. COORDINATE DIMENSIONS AT CLOSETS W/ INTENDED ELEVATOR SPECIFICATIONS, WHERE

APPLICABLE. 12. HARDSCAPE SLOPES INDICATED FOR REFERENCE ONLY. ACTUAL SLOPES VARY BY SITE. SIDEWALK SLOPES ARE NOT TO EXCEED 5% TO REMAIN WHEELCHAIR ACCESSIBLE WITHOUT THE NEED FOR

HANDRAILS. 13. ALL DIMENSIONS SHOWN ARE MEASURED FROM FACE-OF-STUD UNLESS OTHERWISE NOTED.

**ABBREVIATIONS** 

CLR. - CLEAR F.F. - FINISH FLOOR T.O. - TOP OF

## Urban Cottage 3.2

2 STORY: 4 BED, 3 BATH HOME

DATE


2020


## Dimensioned Plans


A-101

Door Schedule							
Door	Panel						
Number	Width	Height	Thickness	Comments			
100	3' - 0"	7' - 8"	0' - 1 3/8"				
101	2' - 6"	7' - 0"	0' - 1 1/2"				
102	3' - 0"	7' - 0"	0' - 1 1/2"				
103	5' - 0"	7' - 0"	0' - 1 1/2"	Bifold			
104	3' - 0"	7' - 0"	0' - 1 1/2"				
105	4' - 0"	7' - 0"	0' - 1 1/2"	Sliding			
106	3' - 0"	7' - 8"	0' - 1 3/8"				
107	3' - 0"	7' - 0"	0' - 1 1/2"				
108	1' - 6"	7' - 0"	0' - 1 1/2"				
109	3' - 0"	7' - 0"	0' - 1 1/2"				
110	8' - 0"	7' - 0"	0' - 1 1/2"	Sliding			
111	3' - 0"	7' - 0"	0' - 1 1/2"				
112	3' - 0"	7' - 0"	0' - 1 1/2"	Pocket			
113	1' - 6"	7' - 0"	0' - 1 1/2"				
114	3' - 0"	7' - 0"	0' - 1 1/2"	Pocket			
115	3' - 0"	7' - 0"	0' - 1 1/2"				
116	5' - 0"	7' - 0"	0' - 1 1/2"	Sliding			


	Window Schedule				
nents	Window Type	Width	Height	Sill Height	
	201	2' - 6"	3' - 10"	3' - 8"	
	202	5' - 0"	4' - 0"	2' - 0"	
	203	3' - 0"	5' - 6"	2' - 2"	
	204	3' - 0"	3' - 0"	2' - 0"	

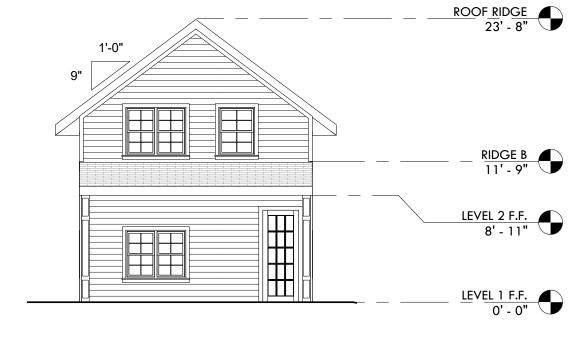




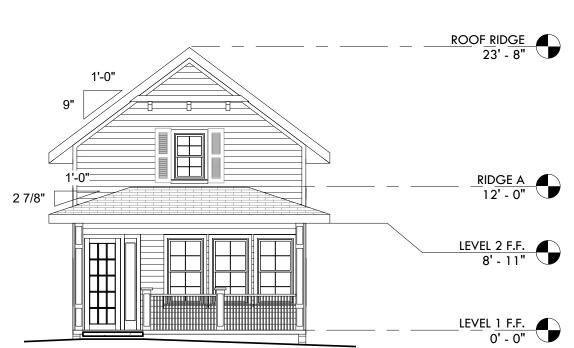



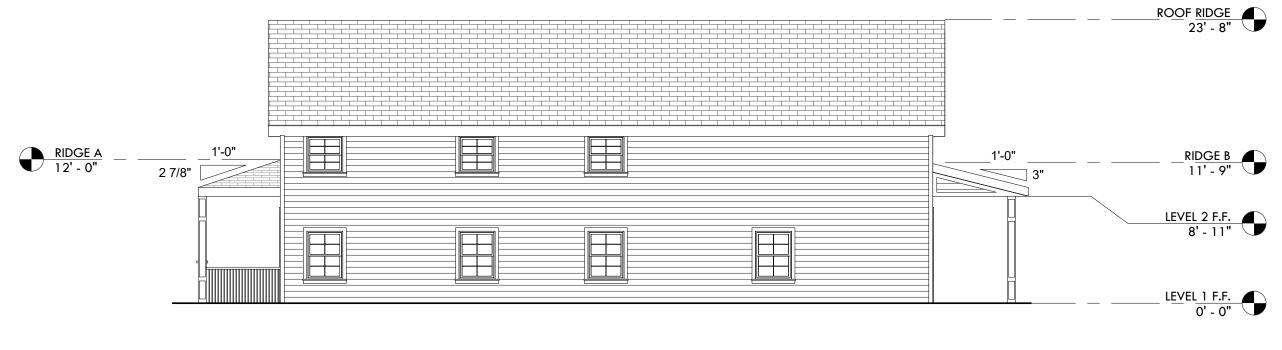

2 EAST ELEVATION 1/8" = 1'-0"

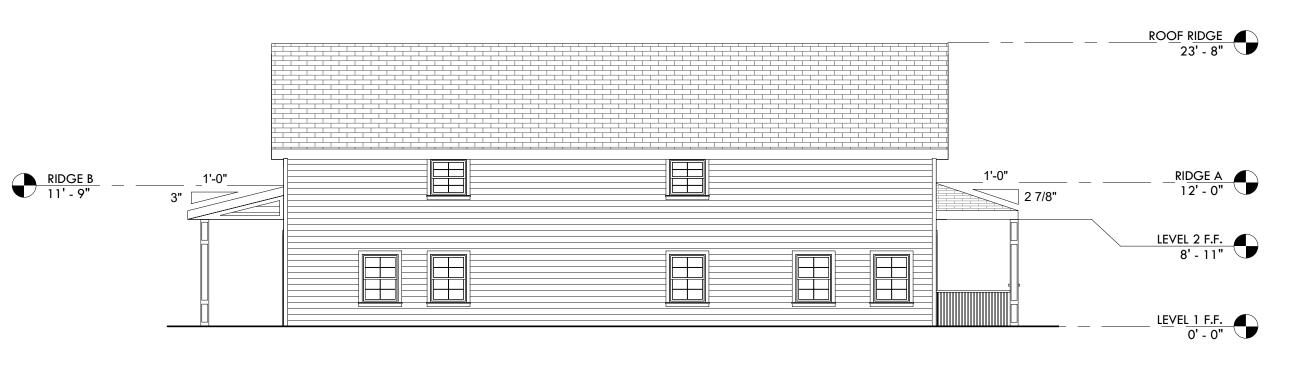

4 WEST ELEVATION 1/8" = 1'-0"

University at Buffalo

Center for Inclusive Design and Environmental Access School of Architecture and Planning

> 309 Hayes Hall Buffalo, NY 14214-8030 TEL: (716) 829-5902

## NOT FOR CONSTRUCTION

NOTES

1. EXTERIOR WALL STUDS ARE ASSUMED 2" X 8" (NOM.). VERIFY IF SUFFICIENT GIVEN REGIONAL ENERGY REQUIREMENTS. 2. INTERIOR WALL STUDS ARE ASSUMED 2" X 4"

3. WALLS ARE ASSUMED 92-5/8" PRE-CUT STUDS W/ ONE BOTTOM PLATE & TWO TOP PLATES. 4. FLOOR JOISTS ARE ASSUMED 2" X 10" (NOM.). VERIFY IF SUFFICIENT BASED ON LOCAL CODE & WOOD SPECIES/GRADE.

5. SUBFLOORS ARE ASSUMED 5/8" PLYWOOD. 6. EXTERIOR WALL SHEATHING IS ASSUMED 5/8" PLYWOOD. SIDING IS NOT DEPICTED IN PLAN VIEW. 7. INTERIOR WALL FINISHES ARE ASSUMED 1/2" DRYWALL.

8. CEILING FINISH IS ASSUMED 5/8" DRYWALL. 9. INTERIOR FLOOR FINISHES ARE NOT DEPICTED IN THIS WORK. FLOOR FINISHES TO BE SMOOTH, STABLE, FIRM, & SLIP-RESISTANT. WHERE CARPET IS PROVIDED, CARPET PILE IS TO BE NO HIGHER THAN 1/2". TRANSITIONS BETWEEN FLOOR FINISHES SHOULD BE SMOOTH & FLUSH WHEREVER POSSIBLE. WHERE NOT POSSIBLE, THE MAXIMUM VERTICAL LEVEL CHANGE IS  $\frac{1}{4}$ ". THE MAXIMUM BEVELED LEVEL CHANGE IS  $\frac{1}{2}$ ", PROVIDED THE TOP 1/4" IS BEVELED AT A MAXIMUM SLOPE OF 1:2.

10. ROOF SLOPES ARE EQUAL ON EITHER SIDE OF RIDGE UNLESS OTHERWISE NOTED. 11. COORDINATE DIMENSIONS AT CLOSETS W/ INTENDED ELEVATOR SPECIFICATIONS, WHERE

APPLICABLE. 12. HARDSCAPE SLOPES INDICATED FOR REFERENCE ONLY. ACTUAL SLOPES VARY BY SITE. SIDEWALK SLOPES ARE NOT TO EXCEED 5% TO REMAIN WHEELCHAIR ACCESSIBLE WITHOUT THE NEED FOR

HANDRAILS. 13. ALL DIMENSIONS SHOWN ARE MEASURED FROM FACE-OF-STUD UNLESS OTHERWISE NOTED.

ABBREVIATIONS
CLR. - CLEAR
F.F. - FINISH FLOOR
T.O. - TOP OF

Urban Cottage 3.2

2 STORY: 4 BED, 3 BATH HOME

DATE

Exterior Elevations

2020

A-201