



University at Buffalo
Center for Inclusive Design and Environmental Access School of Architecture and Planning

> 309 Hayes Hall Buffalo, NY 14214-8030 TEL: (716) 829-5902

NOT FOR CONSTRUCTION

NOTES

1. EXTERIOR WALL STUDS ARE ASSUMED 2" X 8" (NOM.). VERIFY IF SUFFICIENT GIVEN REGIONAL ENERGY REQUIREMENTS. 2. INTERIOR WALL STUDS ARE ASSUMED 2" X 4"

3. WALLS ARE ASSUMED 92-5/8" PRE-CUT STUDS W/ ONE BOTTOM PLATE & TWO TOP PLATES.

VERIFY IF SUFFICIENT BASED ON LOCAL CODE & WOOD SPECIES/GRADE. 5. SUBFLOORS ARE ASSUMED 5/8" PLYWOOD.

4. FLOOR JOISTS ARE ASSUMED 2" X 10" (NOM.).

6. EXTERIOR WALL SHEATHING IS ASSUMED 5/8" PLYWOOD. SIDING IS NOT DEPICTED IN PLAN VIEW. 7. INTERIOR WALL FINISHES ARE ASSUMED 1/2" DRYWALL. 8. CEILING FINISH IS ASSUMED 5/8" DRYWALL.

9. INTERIOR FLOOR FINISHES ARE NOT DEPICTED IN THIS WORK. FLOOR FINISHES TO BE SMOOTH, STABLE, FIRM, & SLIP-RESISTANT. WHERE CARPET IS PROVIDED, CARPET PILE IS TO BE NO HIGHER THAN $\frac{1}{2}$ ". TRANSITIONS BETWEEN FLOOR FINISHES SHOULD BE SMOOTH & FLUSH WHEREVER POSSIBLE. WHERE NOT POSSIBLE, THE MAXIMUM VERTICAL LEVEL CHANGE IS $\frac{1}{4}$ ". THE MAXIMUM BEVELED LEVEL CHANGE IS $\frac{1}{2}$ ", PROVIDED THE TOP 1/4" IS BEVELED AT A MAXIMUM SLOPE OF 1:2.

10. ROOF SLOPES ARE EQUAL ON EITHER SIDE OF RIDGE UNLESS OTHERWISE NOTED. 11. COORDINATE DIMENSIONS AT CLOSETS W/ INTENDED ELEVATOR SPECIFICATIONS, WHERE

12. HARDSCAPE SLOPES INDICATED FOR REFERENCE ONLY. ACTUAL SLOPES VARY BY SITE. SIDEWALK SLOPES ARE NOT TO EXCEED 5% TO REMAIN WHEELCHAIR ACCESSIBLE WITHOUT THE NEED FOR

13. ALL DIMENSIONS SHOWN ARE MEASURED FROM FACE-OF-STUD UNLESS OTHERWISE NOTED.

ABBREVIATIONS
CLR. - CLEAR
F.F. - FINISH FLOOR
T.O. - TOP OF

Urban Cottage 3.4

1 STORY: 3 BED, 1 BATH HOME

DATE


2020

Dimensioned Plans

A-101

Door Schedule					
Door	Panel				
Number	Width	Height	Thickness	Comments	
				_	
100	3' - 0"	7' - 8"	0' - 1 3/4"		
101	4' - 0"	7' - 0"	0' - 1 1/2"	Barn door	
102	4' - 0"	7' - 0"	0' - 1 1/2"	Bifold	
103	5' - 6"	7' - 0"	0' - 1 1/2"	Bifold	
104	3' - 0"	7' - 0"	0' - 1 1/2"		
105	2' - 0"	7' - 0"	0' - 1 1/2"		
106	1' - 6"	7' - 0"	0' - 1 1/2"		
107	3' - 0"	7' - 0"	0' - 1 1/2"		
108	3' - 0"	7' - 0"	0' - 1 1/2"	Bifold	
109	2' - 6"	7' - 0"	0' - 1 1/2"	Bifold	
110	3' - 0"	7' - 0"	0' - 1 1/2"		
111	5' - 0"	7' - 0"	0' - 1 1/2"	Sliding	
112	3' - 0"	7' - 0"	0' - 1 1/2"		
113	5' - 0"	7' - 0"	0' - 1 1/2"	Sliding	
114	2' - 8"	7' - 0"	0' - 1 3/4"		
115	ייס יכ	7' 0"	0' 4 2/4"		

Window Schedule					
Window Type	Width	Height	Sill Heig		
201	5' - 0"	4' - 0"	2' - 0"		
202	3' - 0"	4' - 0"	3' - 0"		
203	3' - 0"	5' - 6"	2' - 2"		

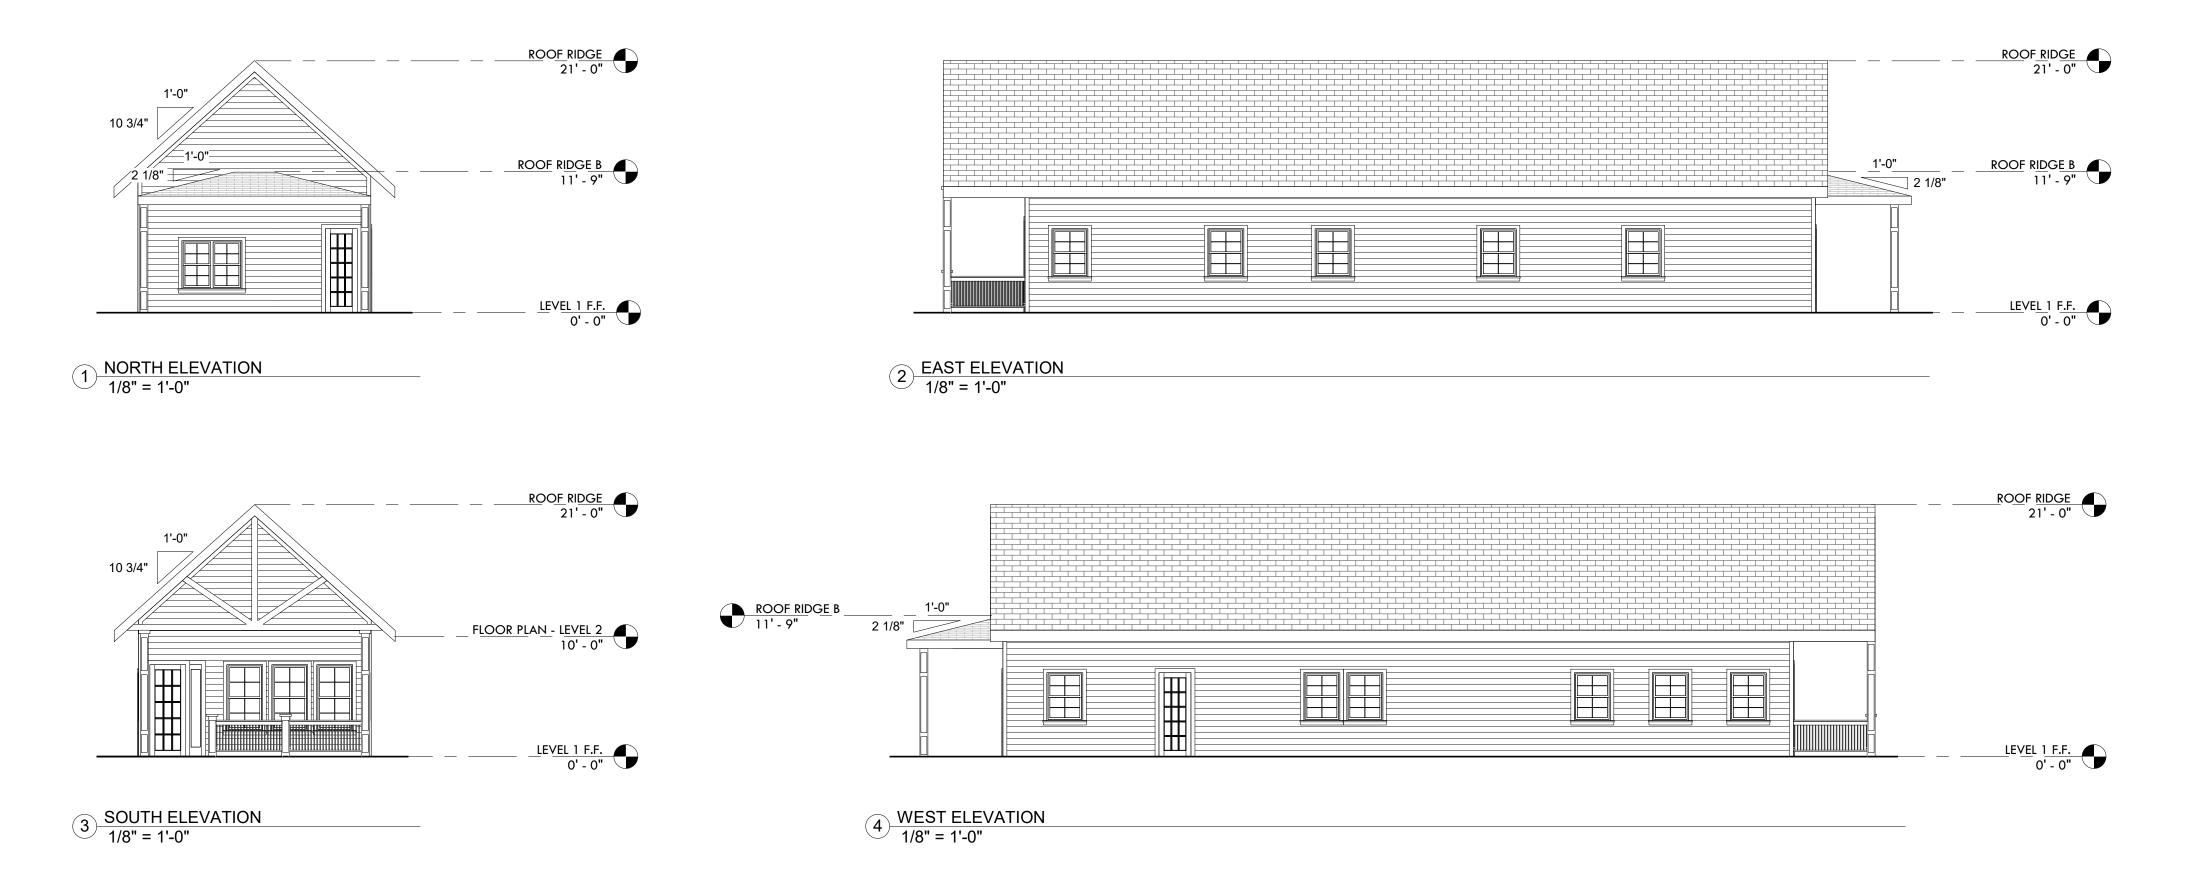

University at Buffalo Center for Inclusive Design

and Environmental Access School of Architecture and Planning

Buffalo, NY 14214-8030 TEL: (716) 829-5902

309 Hayes Hall

NOT FOR CONSTRUCTION

_NOTES__

1. EXTERIOR WALL STUDS ARE ASSUMED 2" X 8" (NOM.). VERIFY IF SUFFICIENT GIVEN REGIONAL ENERGY REQUIREMENTS.

2. INTERIOR WALL STUDS ARE ASSUMED 2" X 4"

3. WALLS ARE ASSUMED 92-5/8" PRE-CUT STUDS W/ ONE BOTTOM PLATE & TWO TOP PLATES. 4. FLOOR JOISTS ARE ASSUMED 2" X 10" (NOM.). VERIFY IF SUFFICIENT BASED ON LOCAL CODE & WOOD SPECIES/GRADE.

5. SUBFLOORS ARE ASSUMED 5/8" PLYWOOD. 6. EXTERIOR WALL SHEATHING IS ASSUMED 5/8" PLYWOOD. SIDING IS NOT DEPICTED IN PLAN VIEW. 7. INTERIOR WALL FINISHES ARE ASSUMED 1/2"

DRYWALL. 8. CEILING FINISH IS ASSUMED 5/8" DRYWALL. 9. INTERIOR FLOOR FINISHES ARE NOT DEPICTED IN THIS WORK. FLOOR FINISHES TO BE SMOOTH, STABLE,

FIRM, & SLIP-RESISTANT. WHERE CARPET IS PROVIDED, CARPET PILE IS TO BE NO HIGHER THAN $\frac{1}{2}$ ". TRANSITIONS BETWEEN FLOOR FINISHES SHOULD BE SMOOTH & FLUSH WHEREVER POSSIBLE. WHERE NOT POSSIBLE, THE MAXIMUM VERTICAL LEVEL CHANGE IS $\frac{1}{4}$ ". THE MAXIMUM BEVELED LEVEL CHANGE IS $\frac{1}{2}$ ", PROVIDED THE TOP 1/4" IS BEVELED AT A MAXIMUM

SLOPE OF 1:2. 10. ROOF SLOPES ARE EQUAL ON EITHER SIDE OF RIDGE UNLESS OTHERWISE NOTED. 11. COORDINATE DIMENSIONS AT CLOSETS W/

INTENDED ELEVATOR SPECIFICATIONS, WHERE APPLICABLE. 12. HARDSCAPE SLOPES INDICATED FOR REFERENCE

ONLY. ACTUAL SLOPES VARY BY SITE. SIDEWALK SLOPES ARE NOT TO EXCEED 5% TO REMAIN WHEELCHAIR ACCESSIBLE WITHOUT THE NEED FOR

13. ALL DIMENSIONS SHOWN ARE MEASURED FROM FACE-OF-STUD UNLESS OTHERWISE NOTED.

ABBREVIATIONS CLR. - CLEAR

F.F. - FINISH FLOOR T.O. - TOP OF

Urban Cottage 3.4

1 STORY: 3 BED, 1 BATH HOME

DATE

Exterior Elevations

2020

A-201